

# WEST HOLLYWOOD

8300 Santa Monica Boulevard West Hollywood, CA 90069-6216

**Building & Safety Division**

tel 323.848.6475 fax 323.848.6569

Where parking spaces are provided, parking spaces shall be provided in accordance with Section 11B-208 of the California Building Code.

Accessible parking spaces shall be provided in accordance with **Table 11B-208.2** as noted below. *(Except for hospital outpatient facilities, rehabilitation facilities, outpatient physical therapy facilities, and residential facilities (CBC 11B-208.2.1 - 11B-208.2.3)).*

**Minimum Number.** Where more than one parking facility is provided on a site, the number of accessible spaces provided on the site shall be calculated according to the number of space required for each parking facility.

**Table 11B-208.2**  
**Parking Spaces Required**

TOTAL NUMBER OF PARKING SPACES IN LOT OR GARAGE	MINIMUM REQUIRED NUMBER OF SPACES
1-25	1
26-50	2
51-75	3
76-100	4
101-150	5
151-200	6
201-300	7
301-400	8
401-500	9
501-1,000	2% of total
1,001 and over	**


\*\* 20 plus one for each 100, or fraction thereof, over 1,000.

**Van Parking Spaces.** For every six or fraction of six parking spaces required, at least one shall be a van parking space (CBC 11B-208.2.4).

**Location.** Accessible parking spaces that serve a particular building or facility shall be located on the shortest accessible route from parking to an entrance. Where parking serves more than one accessible entrance, parking spaces complying with Section 11B-502 shall be dispersed and located on the shortest accessible route to the accessible entrances. In parking facilities that do not serve a particular building or facility, parking spaces shall be located on the shortest accessible route to an accessible pedestrian entrance of the parking facility (CBC 11B-208.3). **(Figure 1)**

**Access Aisle.** Access aisles shall adjoin an accessible route. Two parking spaces shall be permitted to share a common access aisle (CBC 11B-502.3).

Access aisles shall not overlap the vehicular way. Access aisles shall be permitted to be placed on either side of the parking space except for van parking spaces which shall have access aisles located on the passenger side of the parking spaces (CBC 11B-502.3.4).

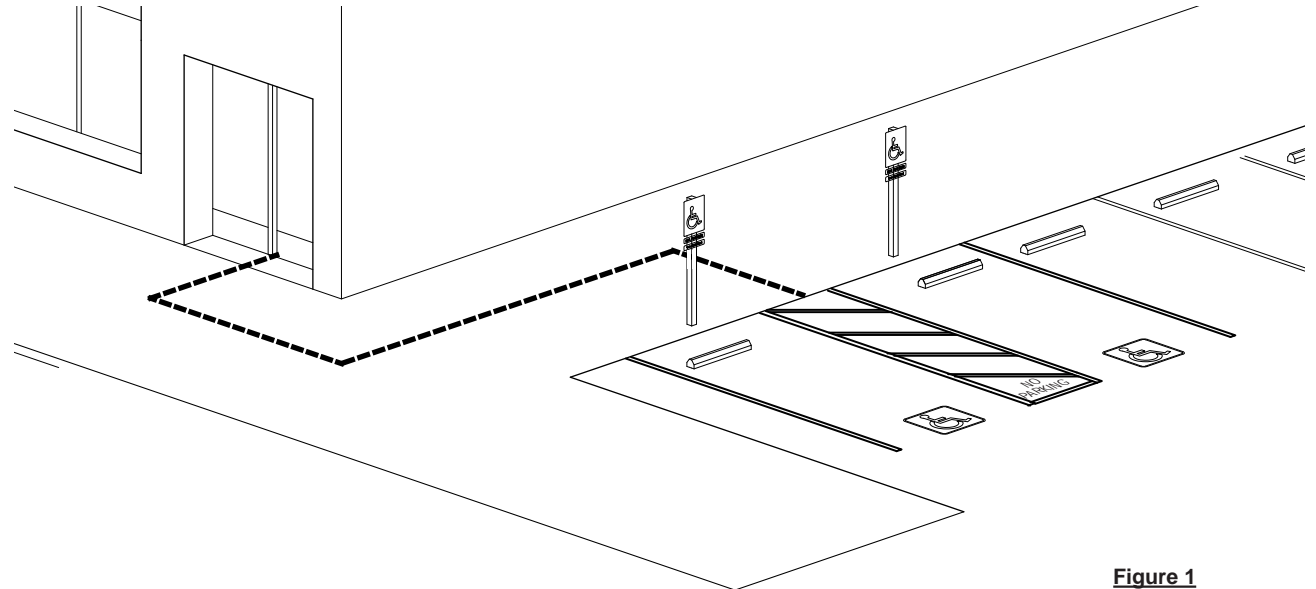

**Figure 1**



Car and Van parking spaces shall be provided in accordance with CBC 11B-502.

**Vehicle Space.** Car and van parking spaces shall be 18 feet long minimum. Car parking spaces shall be 9 feet wide minimum and van parking spaces shall be 12 feet wide minimum, shall be marked to define the width, and shall have an adjacent access aisle (CBC11B-502.2).


*Exception: Van parking spaces shall be permitted to be 9 feet wide minimum where the access aisle is 8 feet wide minimum. \*(See alternate dimension).*

**Access Aisle. Width** - Access aisles serving car and van parking spaces shall be 5 feet wide minimum. **Length** - Access aisles shall extend the full required length of the parking spaces they serve (CBC 11B-502.3). Access aisles shall not overlap the vehicular way. Access aisles shall be permitted to be placed on either side of the parking space except for van parking spaces which shall have access aisles located on the passenger side of the parking spaces (CBC 11B-502.3.4).

**Floor or Ground Surfaces.** Access aisles shall be at the same level as the parking spaces they serve. Changes in level are not permitted (CBC 11B-502.4). Floor and ground surfaces shall be stable, firm, and slip resistant (CBC 11B-302).

**Vertical Clearance.** Parking spaces, access aisles and vehicular routes serving them shall provide a vertical clearance of 98 inches (8' - 2") minimum (CBC 11B-502.5).

**Figure 2 - Perpendicular Parking**

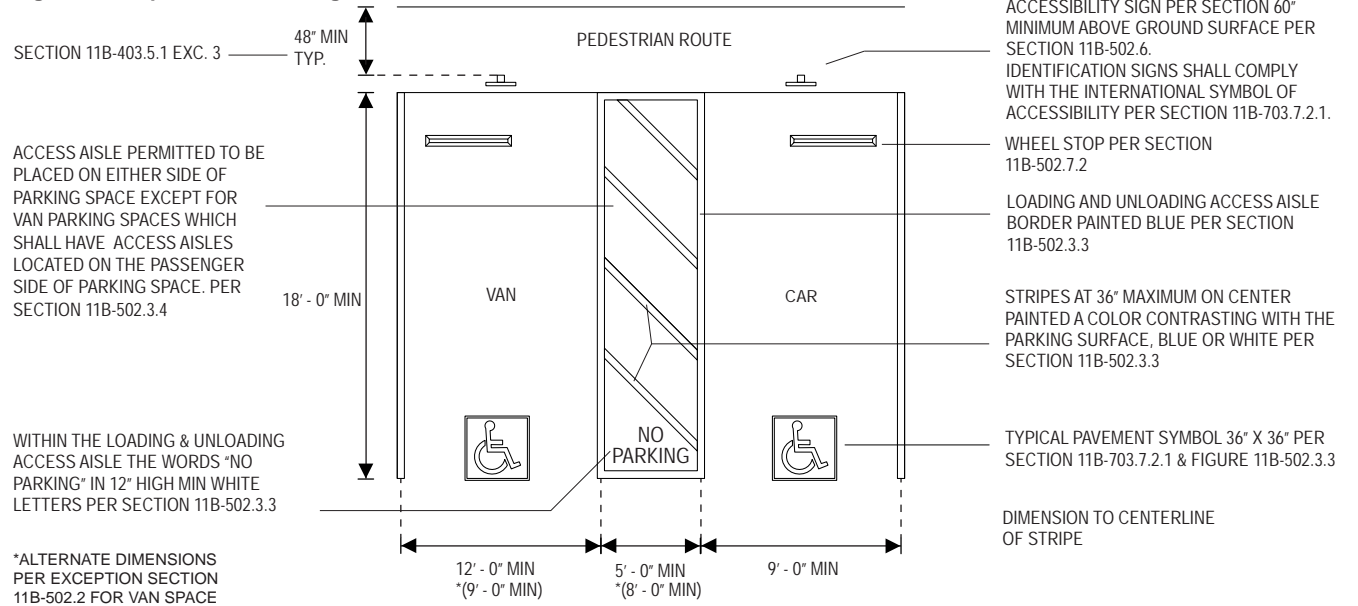

**Figure 3 - Angled Parking**

